

# **EC Motor Supplemental Manual**

Supplemental Manual for Options

EV450 HE1X HE1.5X











## **▲ WARNING**

RISK OF FIRE, ELECTRIC SHOCK, OR INJURY. OBSERVE ALL CODES AND THE FOLLOWING:

- Before servicing or cleaning the unit, switch power off at disconnect switch or service
  panel and lockout/tag-out to prevent power from being switched on accidentally. More
  than one disconnect switch may be required to de0energize the equipment for servicing.
- 2. This installation manual shows the suggested installation method. Additional measures may be required by local codes an standards.
- 3. Installation work and electrical wiring must be done by qualified professional(s) in accordance with all applicable codes, standards and licensing requirements.
- 4. Any structural alterations necessary for installation must comply with all applicable building, health, and safety code requirements.
- 5. This unit must be grounded.
- 6. Sufficient air is needed for proper combustion and exhausting of gases through the flue (chimney) of fuel burning equipment that might be installed int he area affected by this equipment. If this unit is exhausting air from a space in which chimney vented fuel burning equipment is located, take steps to assure that combustion air supply is not affected. Follow the heating equipment manufacturer's requirements and the combustion air supply requirements of applicable codes and standards.
- 7. Use the unit only in the manner intended by the manufacturer. If you have questions, contact the manufacturer.
- 8. This unit is inteded for general ventilating only. Do not use to exhaust hazardous or explosive materials and vapors. Do not connect this unit to range hoods, fume hoods, or collection systems for toxics.
- 9. When cutting or drilling into wall or ceiling, do not damage electrical wiring and other hidden utilities.
- 10. If installed indoors, this unit must be properly ducted to the outdoors.

# **A** CAUTION

When an external 10 VDC source control is used, the maximum distance between the EC Motor and 10 VDC source control cannot exceed 33 ft (10 m).

# **A** CAUTION

Make sure clean filters are installed before balancing airflow. Dirty or clogged filters reduce airflow through the unit.

## **A** CAUTION

To avoid motor bearing damage and noisy and/or unbalanced impellers, keep drywall spray, construction dust, etc., out of unit.

## **A** CAUTION

Very low airflow rates may result in fouling of the energy exhanger core. Do not reduce airflow to below 250 cfm per core.



1.0 OVERVIEW	4
1.1 DESCRIPTION	
2.0 PERFORMANCE DATA	5
2.1 EV450IN ECM OPERATING RANGE	5
2.2 EV450RT ECM OPERATING RANGE	5
2.3 HE1XIN (H OR V) ECM OPERATING RANGE	6
2.4 HE1XRT ECM OPERATING RANGE	6
2.5 HE1XRTC ECM OPERATING RANGE  2.5.1 Unit Tied into Separate Ducts	
2.5.2 Unit Tied into Separate Ducts	
2.6 HE1.5XIN (H OR V) ECM OPERATING RANGE	8
2.7 HE1.5XRT ECM OPERATING RANGE	8
3.0 INSTALLATION	9
3.1 PRINCIPLES OF EXTERNAL CONTROL  3.1.1 HE1X and HE1.5X Only	
3.2 ELECTRICAL SPECIFICATIONS	
3.3 WIRING SCHEMATICS BY CONTROL METHOD	10
3.3.1 EV450—Fixed Speed Control	
3.3.2 EV450—0-10 VDC Signal from CO2 Control	
3.3.4 HE1X and HE1.5X—Fixed Speed Control	
3.3.6 HE1X and HE1.5X—0-10 VDC Signal from CO2 Control	13
3.3.7 Speed Control SC-ECM—Accessory Control	13
4.0 OPERATION	14
4.1 AIRFLOW PERFORMANCE	14
4.2 MEASURING AIRFLOW	
4.2.1 Equipment Required	
4.3 AIRFLOW VERSUS PRESSURE DROPS	
5 O FACTORY ASSISTANCE	15



**EC Motors** 

# 1.0 OVERVIEW

## 1.1 DESCRIPTION

RenewAire's light commercial units are offered with optional electronically commutated motors (ECM). EC motors have higher efficiencies with considerable energy savings over a standard permanent split capacitor motor. The ECM offered in RenewAire ERVs are constant torque with a variety of speed control options. The motors operate at fixed speed or variable speed with speed inputs from fixed resistors, potentiometer, or 0–10 Vdc analog signal.


## 1.2 OPERATING CONTROLS

A wide variety of low voltage (24 VAC) control schemes may be selected to meet the ventilation needs of the facility. These include time clock, occupancy sensor, carbon dioxide sensor, and others. Building Management Systems (BMS) may also control the unit with external control by others.



# 2.0 PERFORMANCE DATA


# 2.1 EV450IN ECM OPERATING RANGE

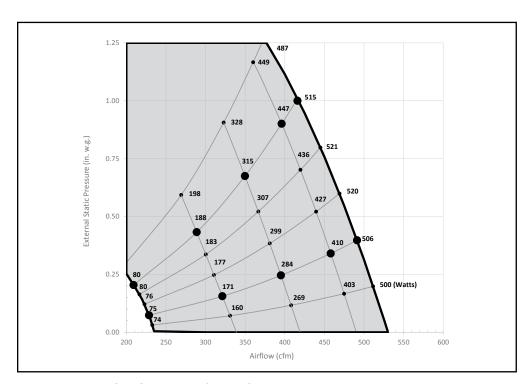

EV450-IN ECM						
Sample Points						
CFM ESP*						
0.07	75					
0.16	171					
0.25	284					
0.34	410					
0.40	506					
0.20	80					
0.43	188					
0.67	315					
0.90	447					
1.00	515					
	mple Poir ESP* 0.07 0.16 0.25 0.34 0.40 0.20 0.43 0.67 0.90					

**Note:** Watts is for the entire unit. \*Inches Water Column

# 2.2 EV450RT ECM OPERATING RANGE

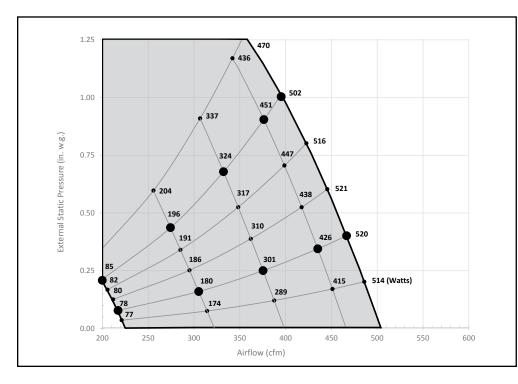


EV450-RT ECM							
Sa	Sample Points						
CFM	ESP*	Watts					
217	0.07	78					
305	0.16	180					
375	0.25	301					
435	435 0.34						
467	0.40	520					
200	0.20	85					
274	0.43	196					
332	0.67	324					
376	0.90	451					
395	1.00	502					

**Note:** Watts is for the entire unit. \*Inches Water Column

# 2.3 HE1XIN (H OR V) ECM OPERATING RANGE

HE1X-IN ECM								
Sample Points								
CFM	CFM ESP*							
324	0.04	86						
446	0.07	150						
647	0.15	300						
794	0.24	564						
929	0.33	827						
1019	0.41	1042						
300	0.11	91						
406	0.20	160						
579	0.42	359						
713	0.65	599						
828	0.89	871						
883	1.00	1075						


**Note:** Watts is for the entire unit. \*Inches Water Column

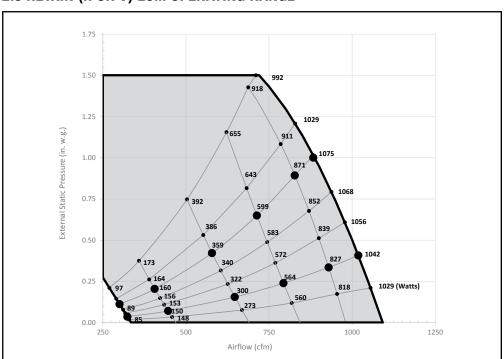

# 2.4 HE1XRT ECM OPERATING RANGE


HE1X-RT ECM							
Sample Points							
CFM	CFM ESP*						
314	0.04	88					
433	0.07	153					
627	0.15	321					
770	0.24	572					
901	0.33	838					
988	0.41	1053					
291	0.11	93					
394	0.20	163					
561	0.42	368					
692	0.65	612					
803	0.89	881					
857	1.01	1074					

**Note:** Watts is for the entire unit. \*Inches Water Column

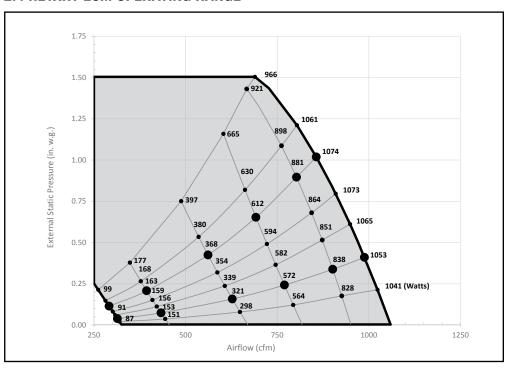


# 2.5 HE1XRTC ECM OPERATING RANGE

# 2.5.1 Unit Tied into Separate Ducts

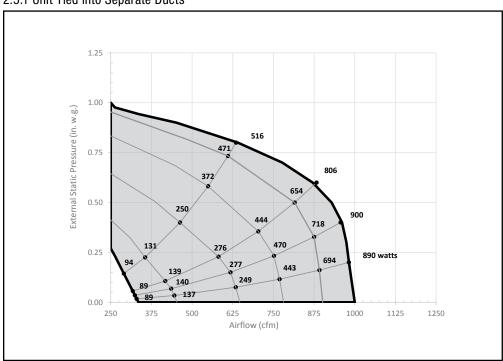

# 2.5.2 Unit Tied into Air-Handler

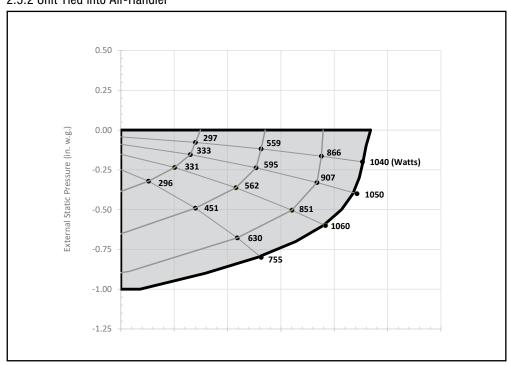




# 2.6 HE1.5XIN (H OR V) ECM OPERATING RANGE

HE1.5X-IN ECM							
Sample Points							
CFM ESP*							
0.07	189						
0.12	314						
0.20	502						
0.28	735						
0.39	1015						
0.20	185						
0.33	310						
0.52	498						
0.74	735						
1.01	1017						
	mple Poir ESP* 0.07 0.12 0.20 0.28 0.39 0.20 0.33 0.52 0.74						


**Note:** Watts is for the entire unit. \*Inches Water Column

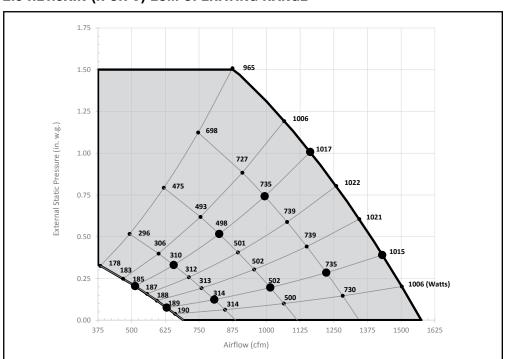

# 2.7 HE1.5XRT ECM OPERATING RANGE

HE1.5X-RT ECM							
Sample Points							
CFM	CFM ESP* Watts						
593	0.07	188					
760	0.12	313					
955	0.20	502					
1151	0.29	739					
1347	0.39	1021					
453	0.20	182					
577	0.33	304					
725	0.51	489					
874	0.74	722					
1026	1.01	1000					

**Note:** Watts is for the entire unit. \*Inches Water Column

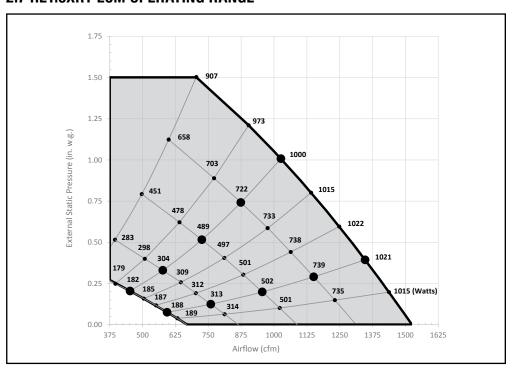

## 3.0 INSTALLATION

## 3.1 PRINCIPLES OF EXTERNAL CONTROL

The light commercial units with EC motors are designed for control by a wide variety of low voltage (24 VAC) controls to meet the ventilation needs of the facility. These include time clock, occupancy sensor, carbon dioxide sensor, building management system (BMS), and others. These devices are commonly known as 2-wire, 3-wire, and 4-wire devices. RenewAire offers separately the following for standalone control of the ERV:

- · Digital Time Clocks TC7D-W and TC7D-E
- Occupancy Sensors MC-C and MC-W
- Carbon Dioxide Sensor/Controllers CO2-W and CO2-D
- · Indoor Air Quality Sensor/Controllers IAQ-W and IAQ-D

#### 3.1.1 HE1X and HE1.5X Only

The external control device connects to the Light Commercial unit to operate each blower independently or for one blower to act as leader and the other blower to act as follower. When operating independently, a single external switch or relay calls for operation but each speed control motor can respond independently to switch or analog signal source.

When acting as leader-follower, again, a single external source calls for operation and then one motor responds to the input signal. The Light Commercial HE1X & HE1.5 units have the versatility that either the exhaust air (EA) motor or the fresh air (FA) motor can act as leader. Connection of an external control device to the Light Commercial Unit is simple. All external control device wires connect to a terminal block(s) in the unit's electrical box.




# **3.2 ELECTRICAL SPECIFICATIONS**


Electrical Ratings for ECM Units									
	Phase (unit)	Input Voltage	MCA (unit)	MOPD (unit)					
EV450	1	115 VAC	8.1	10.1	15				
		208-230 VAC	4.8	6.0	15				
HE1X	1	115 VAC	8.1	18.2	25				
		208-230 VAC	4.8	10.8	15				
HE1.5X	1	115 VAC	8.0	18.0	20				
		208-230 VAC	6.2	14.0	15				

## 3.3 WIRING SCHEMATICS BY CONTROL METHOD


3.3.1 EV450—Fixed Speed Control

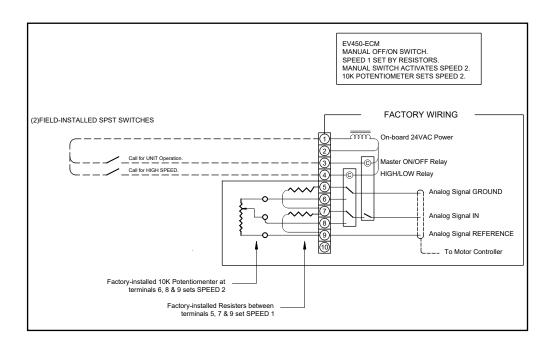

## 3.3.2 EV450—0-10 VDC Signal from External Control or BMS

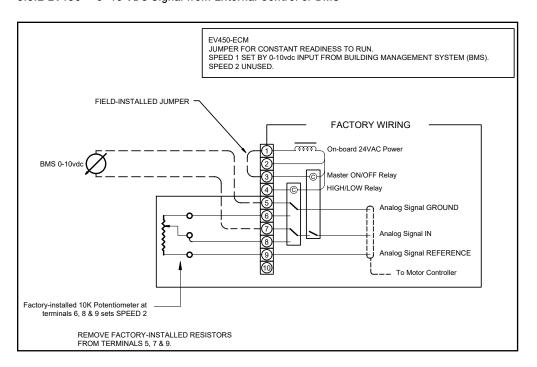


## 3.3.3 EV450-0-10 VDC Signal from CO2 Control

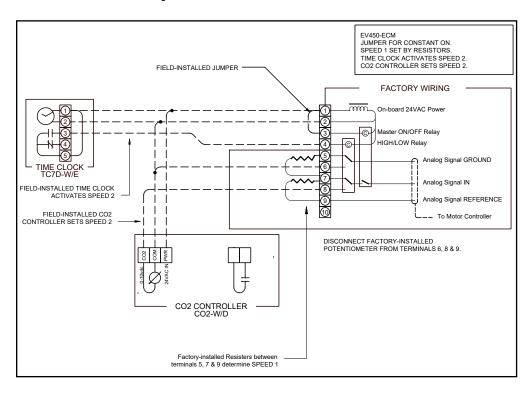




#### 3.3.4 HE1X and HE1.5X—Fixed Speed Control

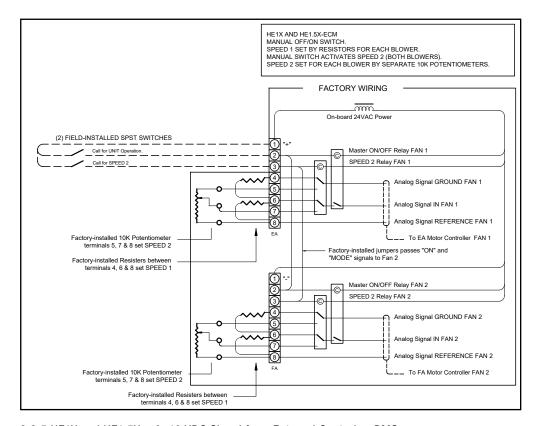


## 3.3.5 HE1X and HE1.5X—0-10 VDC Signal from External Control or BMS

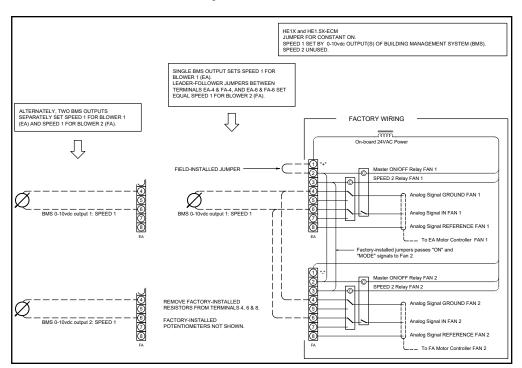




## 3.3.6 HE1X and HE1.5X—0-10 VDC Signal from CO2 Control

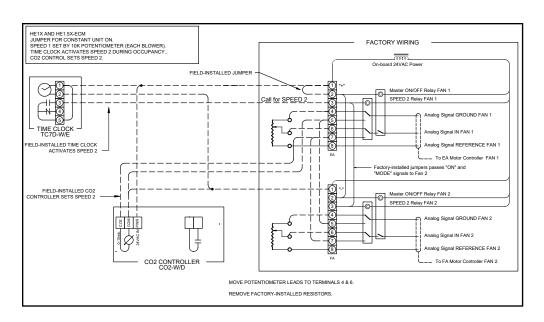

## 3.3.7 Speed Control SC-ECM—Accessory Control

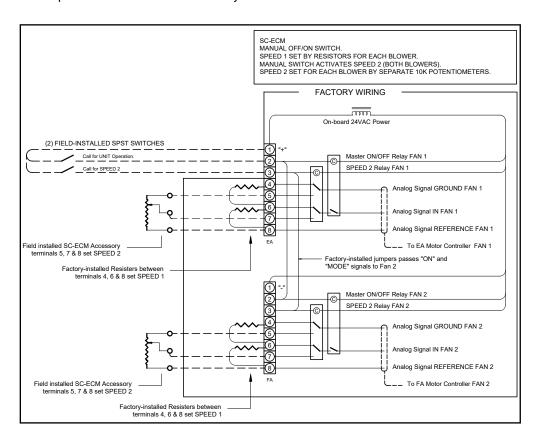



# 4.0 OPERATION

## **4.1 AIRFLOW PERFORMANCE**

The ERV is factory wired to operate at low fixed speed and high variable speed.

Airflows must be measured and the unit's potentiometers adjusted so that it operates at the airflow volumes specified for the installation.

Use the pressure taps in the core and filter doors to determine the airflow. Section 4.3 translates the pressure drop across the energy recovery core to the actual airflow volume.

#### 4.2 MEASURING AIRFLOW


#### 4.2.1 Equipment Required

- Magnehelic gauge or other device capable of measuring 0–1.5 in. water of differential pressure.
- 2 pieces of flexible tubing, 1/8" ID, 1/16" wall works best.


#### 4.2.2 Cross Core Static Pressure Measurement Instructions

- The individual differential pressures (DP) are measured using the installed pressure ports located in the front of the units core access doors.
- To read SCFM of Fresh Air (FA) install the "high" pressure side (+) of your measuring device to the Outside Air (OA) port and the "low" pressure side (-) to the Fresh Air (FA) port.
- To read SCFM of Room Air (RA) install the "high" pressure side (+) of your measuring device to the Room Air (RA) port and the "low" pressure side (-) to the Exhaust Air (EA) port.
- Use the reading displayed on your measurement device to cross reference the CFM output using the conversion chart.
- Adjust airflow by changing the potentiometer setting for the measured airstream.

NOTE: Be sure to remove cap from pressure port before inserting tubing. Insure tubing is well seated in pressure ports.



NOTE: These ports are carefully located on the unit to give the most accurate airflow measurement. Do not relocated ports.



NOTE: For best performance the airflow rate for both the FA and EA should be roughly equal ("balanced"). In some facilities a slight positive or negative pressure in the building is desired. RenewAire energy recovery ventilators can generally operate with a flow imbalance of up to 20% without significant loss in energy recovery efficiency.



## 4.3 AIRFLOW VS. PRESSURE DROPS

AIRFLOW PREDICTED BY PRESSURE DROP ACROSS CORE (SCFM)														
DP	EV450	IN ECM	HE1XIN	E1XINV ECM   HE1XINH ECM   HE1.5XIN ECM   HE1XRT ECM		HE1XRTC ECM		HE1.5XRT ECM						
("H <sub>2</sub> 0)	FA	RA	FA	RA	FA	RA	FA	RA	FA	RA	FA	RA	FA	RA
0.10													335	
0.15							380	320					450	
0.20	200	200	280		260		500	440		1			555	
0.25	225	225	330	270	310	290	620	565		-			650	
0.30	245	245	380	320	360	340	740	695	280	250			745	
0.35	265	265	425	375	415	390	860	825	325	290			835	300
0.40	285	285	470	430	470	440	980	960	370	330			920	380
0.45	305	305	520	480	520	490	1095	1095	415	370			1005	475
0.50	330	330	570	530	570	540	1215	1235	460	410	650		1085	575
0.55	350	350	620	580	620	590	1330	1375	515	455	688		1165	685
0.60	370	370	670	630	670	640	1450	1515	550	500	725	555	1240	805
0.65	390	390	720	680	720	690	1565		595	540	770	610	1315	935
0.70	410	410	770	730	770	740			640	580	815	665	1385	1070
0.75	430	430	815	785	820	790			690	620	853	720	1460	12220
0.80	455	455	860	840	870	840			740	660	890	775	1530	1375
0.85	475	475	910	890	920	890			785	700	933	828		1535
0.90	495	495	960	940	970	940			830	740	975	880		
0.95			1010	990	1020	990			875	785	1018	938		
1.00			1060	1040	1070	1040			920	830	1060	995		
1.05				1090		1090			965	870		1048		
1.10					-				1010	910		1100		

# **5.0 FACTORY ASSISTANCE**

In the unlikely event that you need assistance from the factory for a specific issue with the ERV or its ECM Option, make sure that you have the information called for in the Unit Records pages at the front of the ERV manual. The person you speak with at the factory will need that information to properly identify the unit and the installed options.


## To contact RenewAire Customer Service:

Call 800-627-4499

Email: RenewAireSupport@RenewAire.com

Remember that RenewAire Customer Service can only assist with the ERV and its options, it cannot resolve engineering issues that result from air handling system design by others.



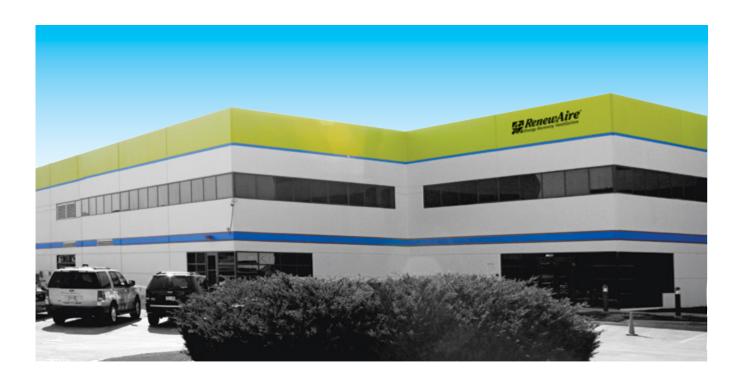

# **About RenewAire**

For over 30 years, RenewAire has been a pioneer in enhancing indoor air quality (IAQ) in commercial and residential buildings of every size. This is achieved while maximizing sustainability through our fifth-generation, static-plate, enthalpic-core Energy Recovery Ventilators (ERVs) that optimize energy efficiency, lower capital costs via load reduction and decrease operational expenses by minimizing equipment needs, resulting in significant energy savings. Our ERVs are competitively priced, simple to install, easy to use and maintain and have a quick payback. They also enjoy the industry's best warranty with the lowest claims due to long-term reliability derived from innovative design practices, expert workmanship and Quick Response Manufacturing (QRM).

As the pioneer of static-plate core technology in North America, RenewAire is the largest ERV producer in the USA. We're **committed to sustainable manufacturing** and lessening our environmental footprint, and to that end our Waunakee, WI plant is 100% powered by wind turbines. The facility is also one of the few buildings worldwide to be LEED and Green Globes certified, as well as having achieved ENERGY STAR Building status. In 2010, RenewAire joined the Soler & Palau (S&P) Ventilation Group in order to provide direct access to the latest in energy-efficient air-moving technologies. For more information, visit: renewaire.com

201 Raemisch Road | Waunakee, WI | 53597 | 800.627.4499 | RenewAire.com





